



# CliniMix® Lead Safe TMV Element and O Ring Service Kit

PRODUCT CODE:  
201.90.39.90



201.90.01.90




201.90.08.90

Item Code:	Description	Where used?
201.90.39.90	CliniMix® Lead Safe Element and O Ring Service Kit	(See components)
Components:		
201.90.01.90	CliniMix® Lead Safe™ TMV O-Ring Kit	201.70.01.09 / 201.70.11.09
201.90.08.90	CliniMix® Lead Safe™ TMV Thermostatic Piston Assembly	201.70.01.09 / 201.70.11.09 / 201.70.02.00

Note: Kit components may be purchased separately.

## INSTALLATION

**INSTALLATION COMPLIANCE:** Galvin Engineering products must be installed in accordance with these installation instructions and in accordance with AS/NZS 3500, the PCA and your local regulatory requirements. Water and/or electrical supply conditions must also comply to the applicable national and/or state standards. Failing to comply with these provisions shall void the product warranty and may affect the performance of the product.

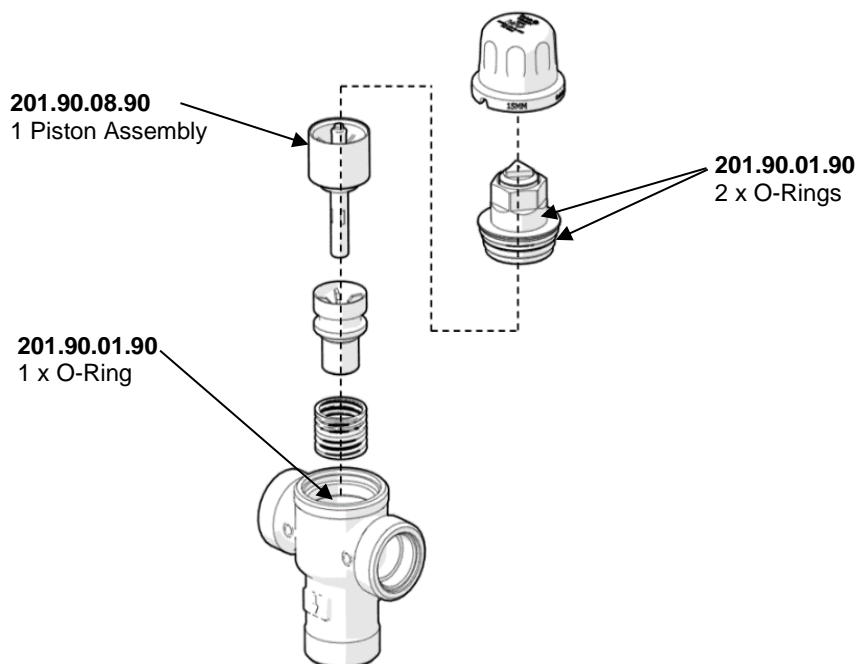

**WARRANTY**

Galvin Engineering products are covered under our Manufacturer's Warranty. Galvin Engineering products must be installed in accordance with the installation instructions and in accordance with AS 3500 and NCC Volume Three, relevant Australian Standards and local authorities applicable to product being installed. Water and electrical supply conditions must also comply to the applicable national and/or state standards, failing to comply with these provisions may void the product warranty and affect performance of the product.

Please visit [www.galvinengineering.com.au](http://www.galvinengineering.com.au) to view the full warranty, our Installation Compliance and Maintenance & Cleaning information as well as any other additional information.